



4

\*ST / AT / DATA / DATA 2 / DALI

4.1 | 1.4 → 1.5 → 3.2a\* (3.2b\*)

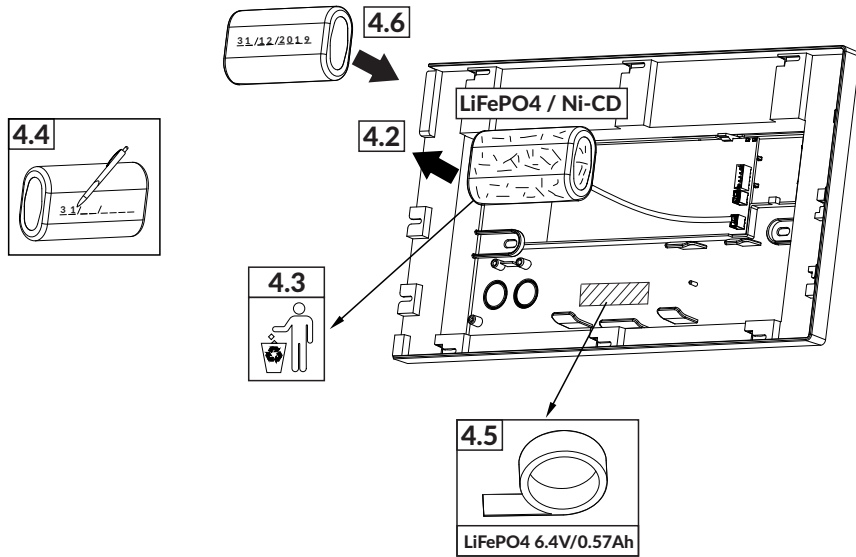

4.7 | 1.14 → 1.15a\* (1.15b\*) → 1.16

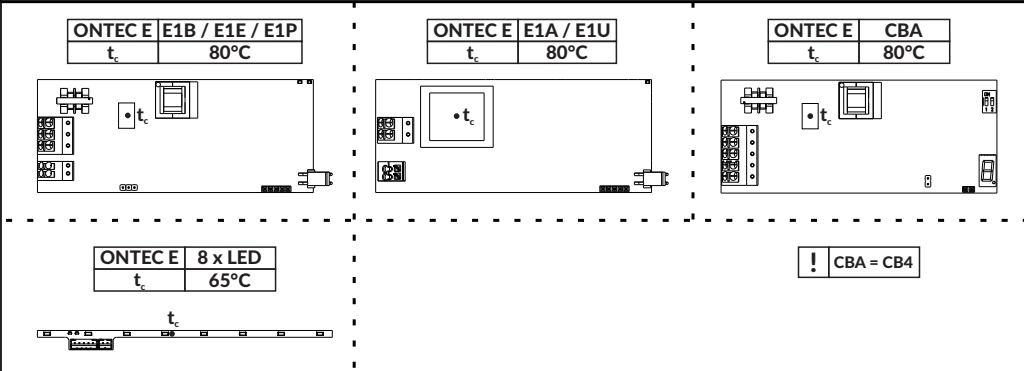

I.OEV1.11/12.02.2021

**TM TECHNOLOGIE**  
emergency & evacuation lighting



IP 20








850 °C



210 ÷ 250 V AC  
50 / 60 Hz  
186 ÷ 254 V DC

**TM.ONTEC E**

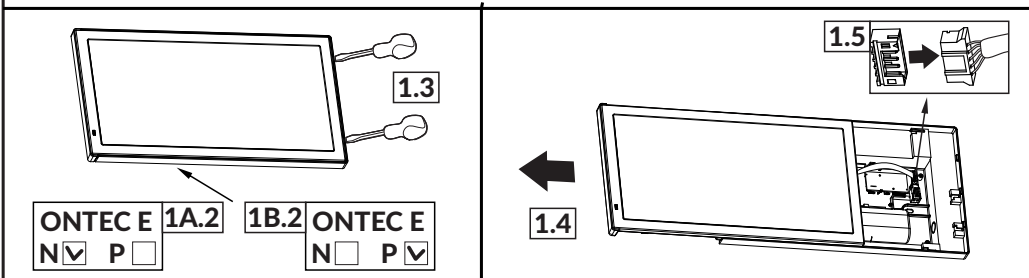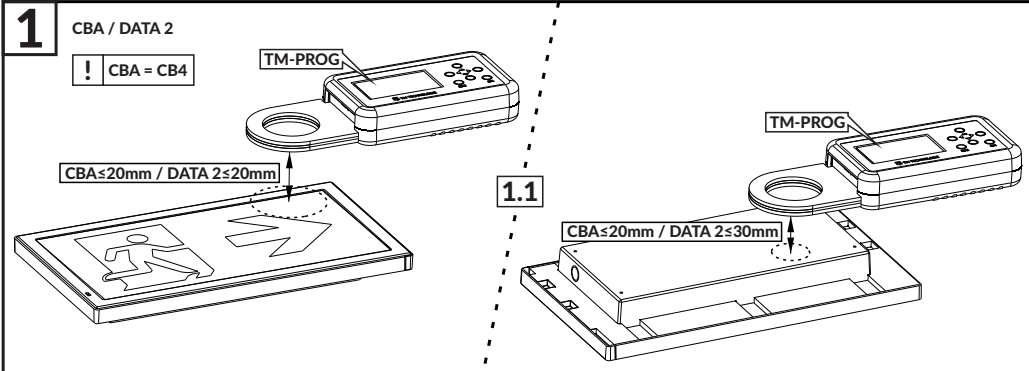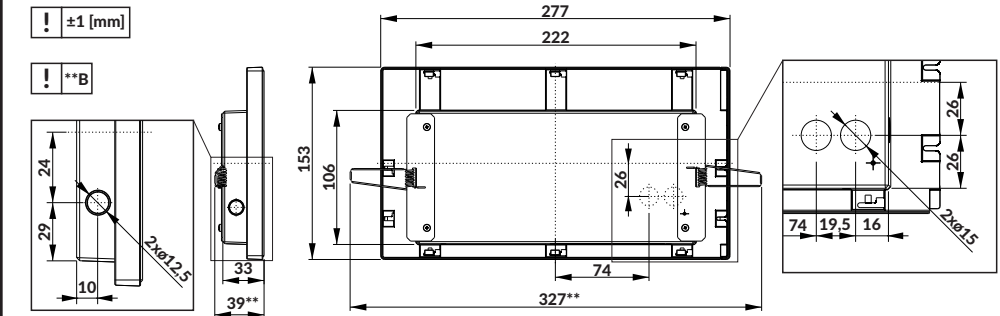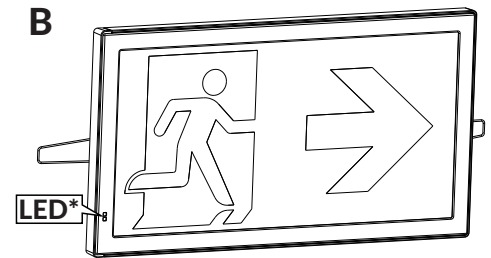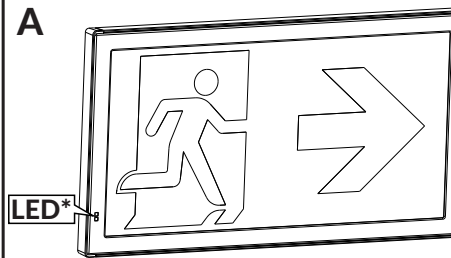

<b>1.12</b> ! CB = CB1 • CBA = CB4		<b>CB3</b> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> L/+N/- CB	<b>DZR</b> 
<b>NM</b> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> N L AB (DA DA)	<b>CB / CBA E</b> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> N/-L/+ CB	<b>CBA P (VIP-RS CB)</b> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> N-L+ N L L1 CB	
<b>M</b> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> N L L1 AB (DA DA)	<b>CB2</b> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> L/+N/- CB	<b>CBA P (VIP-R CB)</b> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> N-L+ L1 L N CB	
		<b>NM / M</b> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>	

! [mm]

176

! [mm]

230

115

**3** 3.1.1.4 → 1.5

3.2a\* 3.2b\*

3.3.1.6

3.4

3.5

3.6 1.9 → 1.10 → 1.14 → 1.15a(1.15b) → 1.16